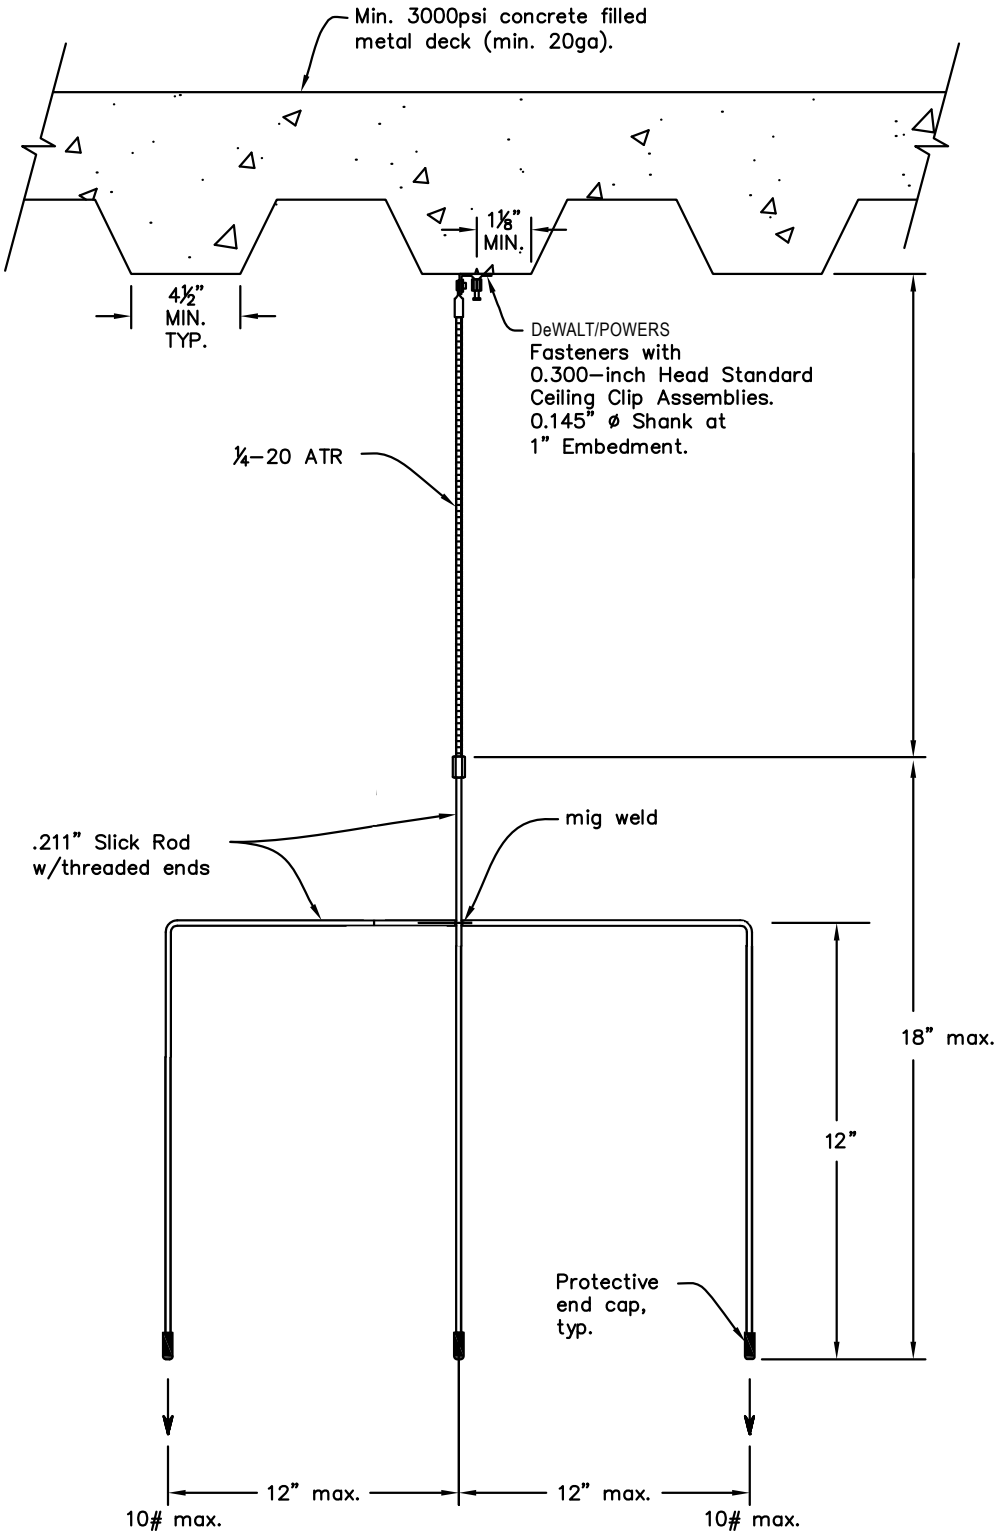

- Powers Head Ceiling Clip & Pin per ICC ESR–2024.
- Not to exceed 25 lbs total static load.
- Metal deck shall be 20 gage min.
- Conduit shall be independently supported.
- Electrical system installation shall comply with NFPA 90 provisions.
- Static loads indicated, notwithstanding conduit/cable attachment allowable load.
- Not for seismic application.

REGISTERED PROFESSIONAL ENGINEER
KAMRAN R. MAJLESSI
NO. C71231
Exp. 06-30-21
CIVIL
STATE OF CALIFORNIA

UL LISTED

FLASHFASTENERS
www.FlashFasteners.com

DETAIL
FLASH PITCHFORK

DRAWN BY: RG | SCALE: NO SCALE